Job Name:	
Tag#	



Submittal Data Sheet

FDXS09LVJU / RXS09LVJU

0.75-Ton Ducted Concealed Heat Pump System







Complete warranty details available from your local dealer or at www.daikincomfort.com. To receive the 12-Year Parts Limited Warranty, online registration must be completed within 60 days of installation. Online registration is not required in California or Quebec. If product is installed in a commercial application, limited warranty period is 5 years.

Indoor Specifications

	Cooling		Heating		
	Н		М	Н	М
Airflow Rate (cfm)	305		280	305	280
	L		SL	L	SL
	260		235	260	235
Sound (dBA) H / M / L	35 / 33 / 31		35 / 3	3 / 31	
Dimensions (H \times W \times D) (in)		7-7/8 × 27-9/16 × 24-7/16			
Weight (Lbs)		47			

Outdoor Specifications

Compressor		Hermetically Sealed Swing Type			
Refrigerant		R-410A			
Factory Charge (Lbs)		2.43			
Refrigerant Oil		PVE (FVC50K)			
			oling	Heating	
Airflow Rate (cfm)	Н	l	1,102	Н	992
	L		989	L	840
Sound Pressure Level (dBA)		47 / 48			
Dimensions (H × W × D) (in)		21-5/8 × 30-1/8 × 11-1/4			
Weight (Lbs)		75			

Efficiency

Cooling		Hea	ting
SEER	15.1	HSPF	10.3
EER	11.2	СОР	3.45

Performance

Cooling (Btu/hr)			
Rated (Min/Max)	8,500 (4,400 / 8,500)		
Sensible @ AHRI	7,130		
Moisture Removal gal/h	2.5		
Standard Operating Range	50°F – 115°F		
Extended Operating Range*	0°F – 115°F		

Rated Cooling Conditions: Indoor: 80°F DB/67°F WB
Outdoor: 95°F DB/75°F WB

*With field settings and wind baffle

Heating (Btu/hr)		
1:@ 47° Rated (Min/Max) 10,000 (4,400 / 10,000)		
2: @ 17° Rated	6,500	
3: @ 5°: Capacity / COP	4,470 / 2.34	
Operating Range	5°F – 65°F	

1: Rated Heating Conditions: Indoor: 70°F DB/60°F WB

Outdoor: 47°F DB/43°F WB

2: Rated Heating Conditions: Indoor: 70°F DB/60°F WB

Outdoor: 17°F DB/15°F WB

3: Heating Conditions: Indoor: 70°F DB/60°F WB

Outdoor: 5°F DB/5°F WB

Electrical

	208/60/1	230/60/1
System MCA	8	8
System MFA	15	15
Compressor RLA	4.1	3.7
Outdoor fan motor FLA	.22	.22
Outdoor fan motor W	23	23
Indoor fan motor FLA	.52	.52
Indoor fan motor W	62	62

MFA: Max. fuse amps MCA: Min. circuit amps (A) FLA: Full load amps (A)

RLA: Rated load amps (A)

W: Fan motor rated output (W)

Piping

Liquid (in)	1/4
Gas (in)	3/8
Drain (in)	25/32
Max. Interunit Piping Length (ft)	65.6
Max. Interunit Height Difference (ft)	49.2
Chargeless (ft)	32.8
Additional Charge of Refrigerant (oz/ft)	.21


Daikin North America LLC 5151 San Felipe, Suite 500 Houston, TX 77056

(Daikin's products are subject to continuous improvements. Daikin reserves the right to modify product design, specifications and information in this data sheet without notice and without incurring any obligations)

Submittal Revision Date: October 2021 Page 1 of 4

FDXS09LVJU Dimensional Data




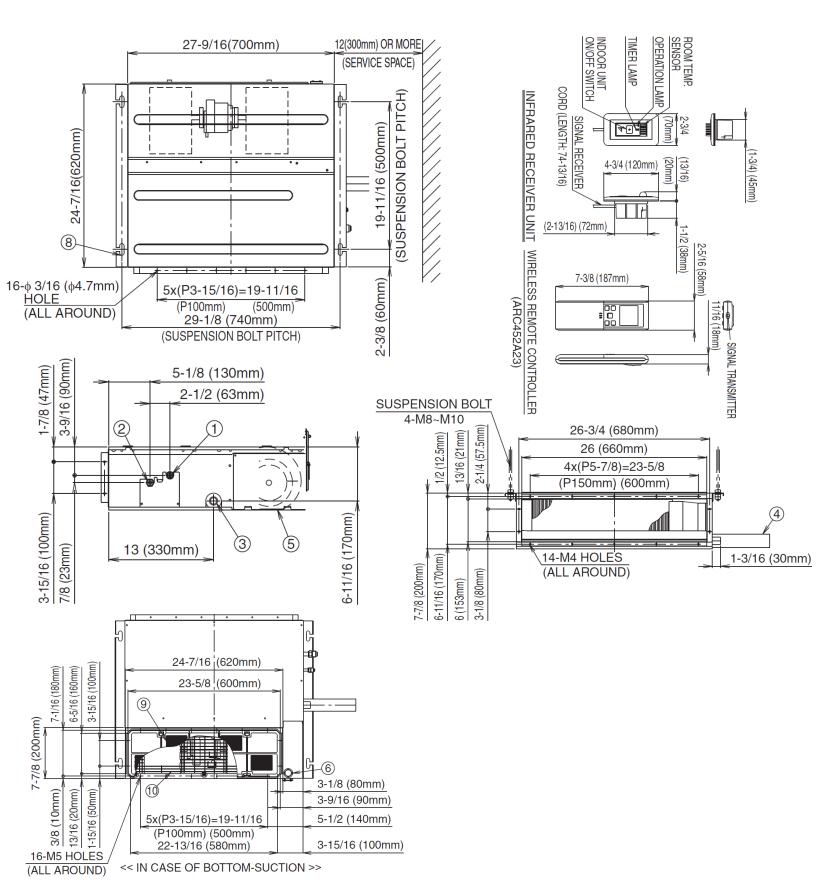

Submittal Revision Date: October 2021 Page 2 of 4

RXS09LVJU Dimensional Data



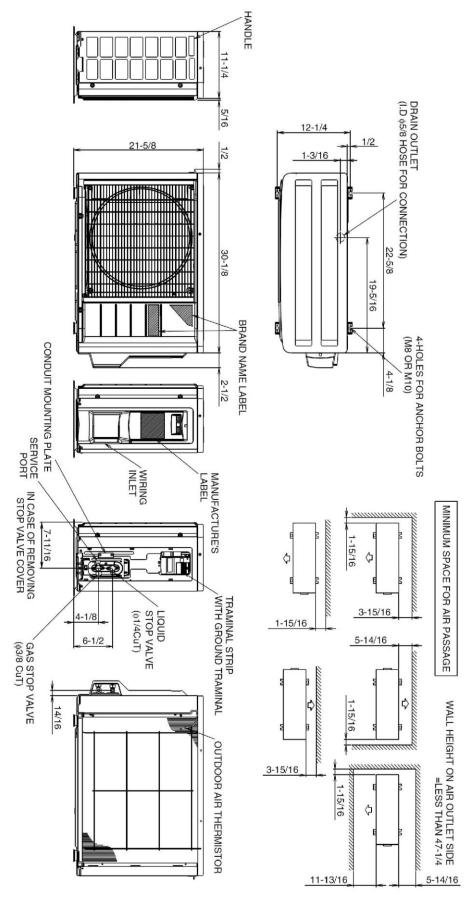

Daikin North America LLC 5151 San Felipe, Suite 500 Houston, TX 77056

(Daikin's products are subject to continuous improvements. Daikin reserves the right to modify product design, specifications and information in this data sheet without notice and without incurring any obligations)

Submittal Revision Date: October 2021 Page 3 of 4




	Indoor Unit			
Included	Part Number	Description		
	AZAI6WSCDKB	DKN Residential Cloud Wi-Fi Adaptor for Single- and Multi-Zone System (S21)		
	AZAI6WSPDKC	DKN Plus Interface		
	DTST-ONE-ADA-A	Daikin One+ Smart Thermostat for Ductless Products		
	BRC944B2	Wired Remote Controller		
	BRCW901A08	Wired Remote Controller Cable – 25ft		
	BRCW901A03	Wired Remote Controller Cable – 10ft		
	DACA-ARCW901P10	IR Receiver Cable, Plenum Rated, 10ft		
	DACA-ARCW901P25	IR Receiver Cable, Plenum Rated, 25ft		
	DACA-CP2-1	Maxi Orange Condensate Pump		
	DACA-CP3-1	Mini Condensate Pump 5 gph		
	KRP928BB2S	Interface Adaptor for DIII-NET		

Outdoor Unit			
Included	Part Number	Description	
	DACA-WB-3	Powder-Coated Wall-Mounted Bracket	
	KEH041A41	Drain Pan Heater RXS09_12LV	
	KKP937A4	Drain Plug for OD Unit	
	KPW937F4	Low Ambient Wind Baffle / Air Adjustment Grille (09/12 MBH)	

External Static Pressure / Airflow Chart



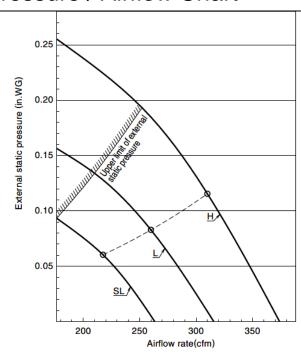

Submittal Revision Date: October 2021 Page 4 of 4